

LPAD7-SOCKET2

LPAD7-SOCKET2-B Mounting Socket

Installation instructions

Instructions de montage





Montageanweisung

Montagevoorschrift


Istruzioni di montaggio





Instrucciones de montaje

Monteringsanvisning




13.6 [0.535]

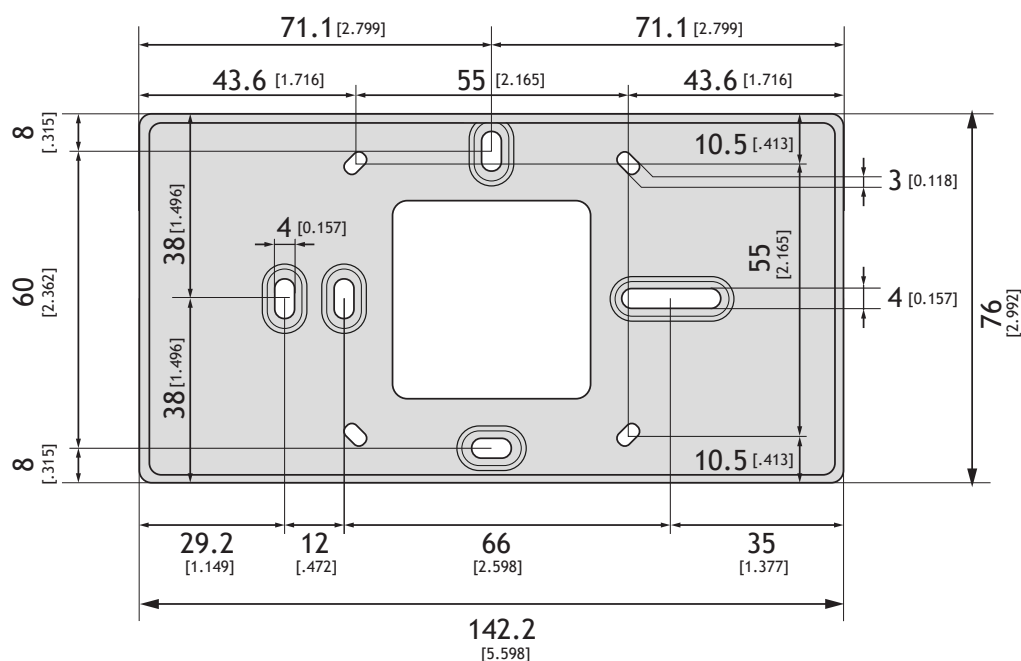

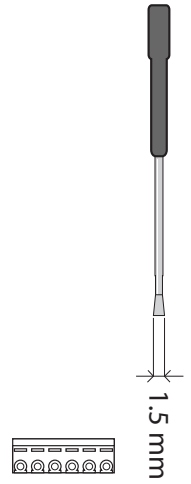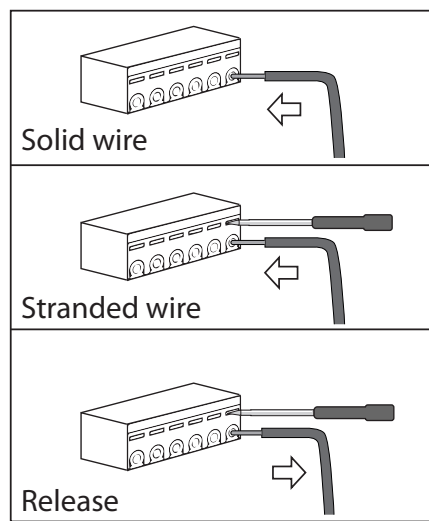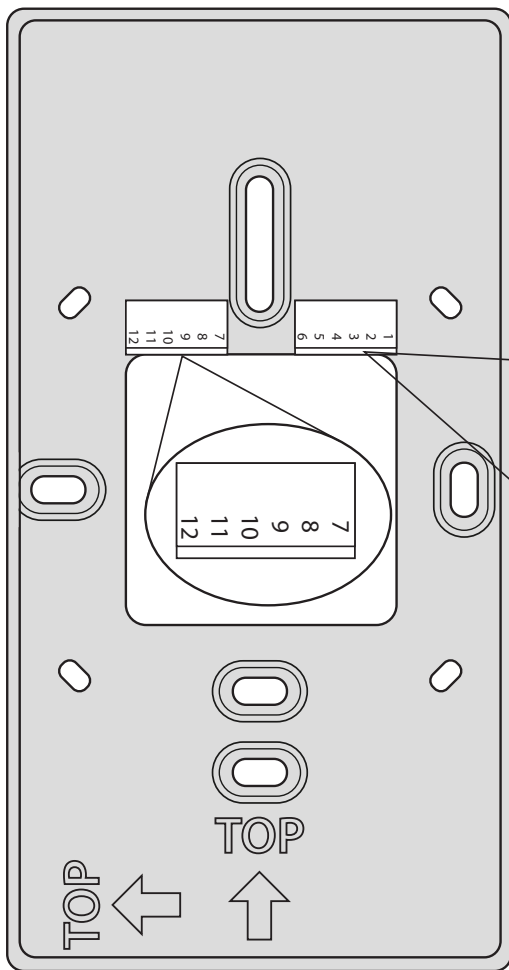


Wire Gauge Size

Code	Accepted Wire Gauge	Max Conductor	Max Insulation
21	18-26 AWG Solid or Stranded	1.20 mm Diameter	2.10 mm Diameter

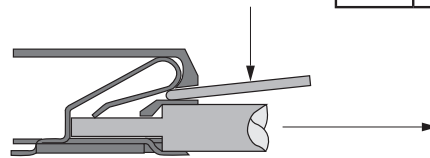


Push screwdriver (not sharp) into slot above wire.
When wire is free, pull to extract.



Connectors			
INPUT 24V AC/DC POWER SUPPLY	1	24V+	! *
	2	24V-/GND	
EXTERNAL BUTTONS	3	Button 1	
	4	Button 2	
	5	Button 3	
	6	GND	
TP/FT-10 CEA-709	7	Input A	
	8	Input B	
	9	not connected (NC)	
RS485	10	RS485-	
	11	RS485+	
	12	GND	

Mounting height:

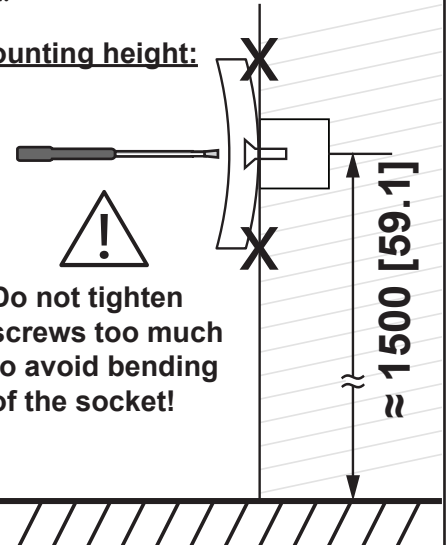

* Power OFF and wait 30s before inserting LPAD!